

BEARING BLOCK NAIL SPACING DETAIL


(SPF & NORTHERN SPECIES LUMBER)

VALUES FROM CSA 086-01 ENGINEERING DESIGN IN WOOD

MINIMUM SPACING FOR SINGLE BEARING BLOCK IS SHOWN. DOUBLE NAIL SPACINGS AND STAGGER NAILING FOR TWO BLOCKS. GREATER SPACING MAY BE REQUIRED TO AVOID SPLITTING.

- A - SPACING PARALLEL TO GRAIN (16 NAIL DIAMETERS - MIN.)
- B - END DISTANCE (12 NAIL DIAMETERS - MIN.)
- C - SPACING OF NAILS IN A ROW (8 NAIL DIAMETERS - MIN.)
- D - EDGE DISTANCE (4 NAIL DIAMETERS - MIN.)

BEARING BLOCK TO BE SAME SPECIES, SIZE AND GRADE AS BOTTOM CHORD.

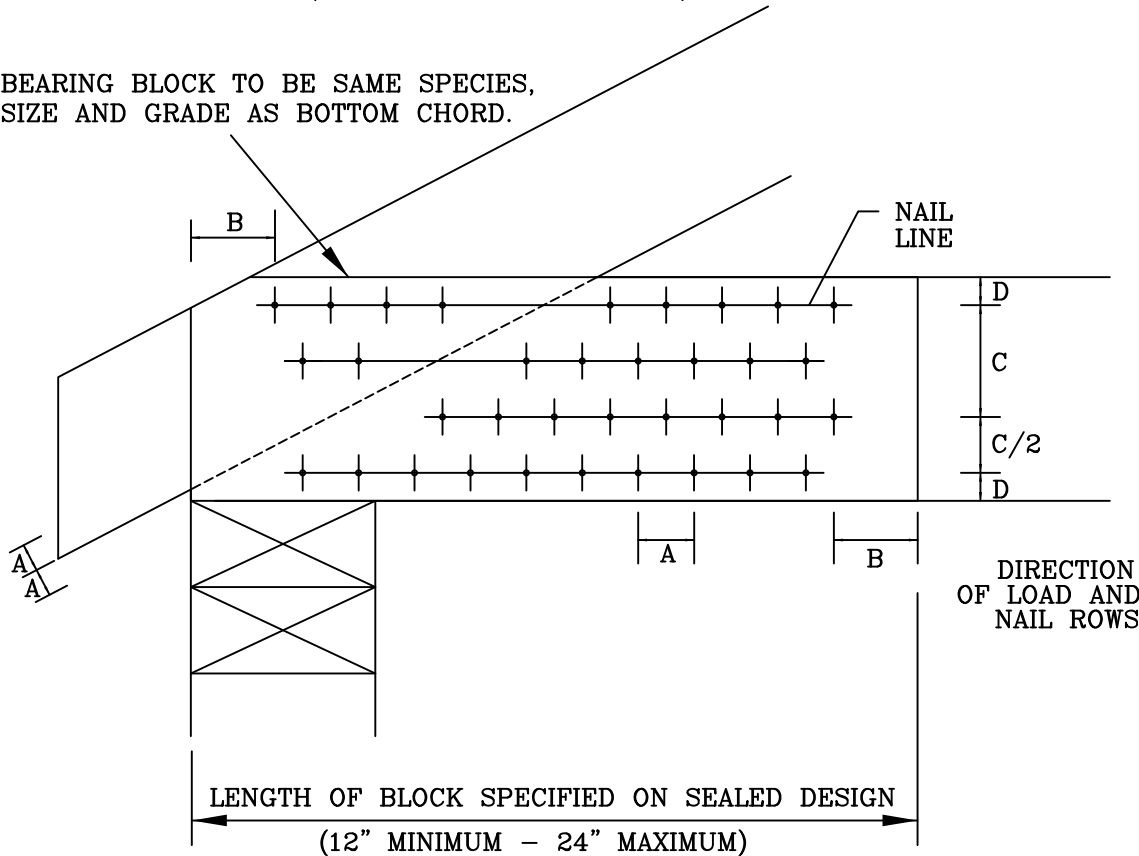

MAXIMUM NUMBER OF NAIL LINES PARALLEL TO GRAIN

NAIL TYPE	DIAM.	CHORD SIZE				
		2X4	2X6	2X8	2X10	2X12
2.5" COMMON NAIL	0.128"	5	8	11	15	18
3.0" COMMON NAIL	0.144"	4	7	10	13	17
3.5" COMMON NAIL	0.160"	3	6	9	12	15
2.5" SPIRAL NAIL	0.109"	6	11	15	19	24
3.0" SPIRAL NAIL	0.122"	6	10	13	17	21
3.5" SPIRAL NAIL	0.152"	4	7	10	13	17
3.25" GUN NAIL	0.128"	5	8	11	15	18

MINIMUM NAIL SPACING DISTANCES ++

NAIL TYPE	DIAM.	DISTANCES			
		A	B	C	D
2.5" COMMON NAIL	0.128"	2-1/8"	1-5/8"	1-1/8"	5/8"
3.0" COMMON NAIL	0.144"	2-3/8"	1-3/4"	1-1/4"	5/8"
3.5" COMMON NAIL	0.160"	2-5/8"	2"	1-3/8"	3/4"
2.5" SPIRAL NAIL	0.109"	1-3/4"	1-3/8"	7/8"	1/2"
3.0" SPIRAL NAIL	0.122"	2"	1-1/2"	1"	1/2"
3.5" SPIRAL NAIL	0.152"	2-1/2"	1-7/8"	1-1/4"	5/8"
3.25" GUN NAIL	0.128"	2-1/8"	1-5/8"	1-1/8"	5/8"

++ - CSA 086-01 ALLOWABLES ROUNDED UP TO NEAREST 1/8"

Visit <http://www.epictruss.com/Specs> for the latest information and warnings



"Combining the Best of"

Valley Truss Ltd.
604-574-3525

Epic Truss Systems
604-850-3522

****WARNING**** TRUSSES REQUIRE EXTREME CARE IN FABRICATING, HANDLING, SHIPPING, INSTALLING AND BRACING. REFER TO BCSI 1-03 (HANDLING, SHIPPING, INSTALLING AND BRACING), PUBLISHED BY TPI (TRUSS PLATE INSTITUTE, 583 D'ONDRIOD DR., SUITE 200, MADISON, WI. 53719) FOR SAFETY PRACTICES PRIOR TO PERFORMING THESE FUNCTIONS. UNLESS OTHERWISE INDICATED, TOP CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE A PROPERLY ATTACHED RIGID CEILING.

****IMPORTANT**** FURNISH A COPY OF THIS DESIGN TO THE INSTALLATION CONTRACTOR. EPIC TRUSS SYSTEMS LTD. SHALL NOT BE RESPONSIBLE FOR ANY DEVIATION FROM THIS DESIGN; ANY FAILURE TO BUILD THE TRUSSES IN CONFORMANCE WITH TPIC; OR FABRICATING, HANDLING, SHIPPING, INSTALLING AND BRACING OF TRUSSES. DESIGN CONFORMS WITH APPLICABLE PROVISIONS OF CSA 086-01 (CANADIAN STANDARDS ASSOCIATION), NBCC (LATEST EDITION), AND TPIC. ALPINE CONNECTORS ARE MADE OF 20GA ASTM A653 GR40 GALV. STEEL EXCEPT AS NOTED. APPLY CONNECTORS TO EACH FACE OF TRUSS AND, UNLESS OTHERWISE LOCATED ON THIS DESIGN, POSITION CONNECTORS PER DRAWINGS 160 A-Z. THE SEAL ON THIS DRAWING INDICATES ACCEPTANCE OF PROFESSIONAL ENGINEERING RESPONSIBILITY SOLELY FOR THE TRUSS COMPONENT DESIGN SHOWN. THE SUITABILITY AND USE OF THIS COMPONENT FOR ANY PARTICULAR BUILDING IS THE RESPONSIBILITY OF THE BUILDING DESIGNER, PER TPIC 96.

REF
DATE 05/06/09

-ENG DL

A-103